


## ABOUT LEAD-SERVICE-LINE INVENTORY

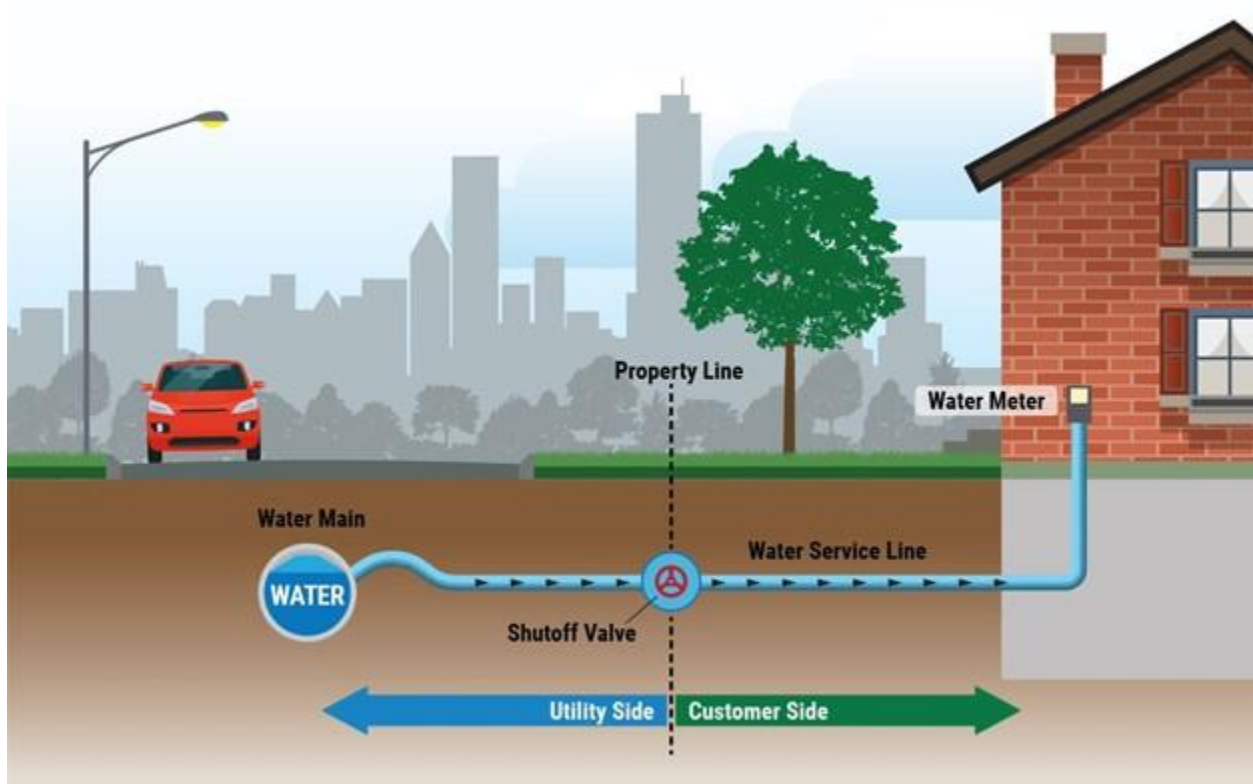

The Arizona Department of Environmental Quality (ADEQ) through the Environmental Protection Agency (EPA) requires that all communities submit a complete Lead Service Line (LSL) inventory. The purpose is to identify and document the materials used in service lines that connect water mains to individual properties, specifically focusing on whether they contain lead.

The Town has used historical records, maintenance records, and utility mapping to best ascertain the type of material for each service line, materials can include copper, PEX, galvanized steel, and PVC. The areas of the community that are older have little to no historical records, as a result, these properties have been labelled “Unknown.” These “Unknown” service lines need to be dug up and identified to complete our service line inventory. To date, the Town has identified over 1600 service lines and has not found any lead service lines.

LABORATORIES THAT COMPLETE LEAD SAMPLING:

**Bradshaw Mountain Environmental**

3050 N. Windsong Dr., Suite 105

Prescott Valley, AZ 86314

928-778-4510

**Legend Tech Services of AZ**

17631 N. 25th Avenue

Phoenix, AZ 85023

602-324-6100

**Eurofins Environ. Testing**

1501 W. Knudsen Drive

Phoenix, AZ 85027

800-651-4802